


Lasciare le impostazioni del rivelatore di default (vedere manuale)
Detector settings to default value (refer to instruction manual)

- LEGENDA/LABEL:
1. INX7XX-AS-C RIVELATORE GAS SERIE INDUSTRIAL/ INDUSTRIAL GAS DETECTOR
 2. SMARTLINE X/XX CENTRALE CONVENZIONALE/ CONVENTIONAL CONTROL PANEL

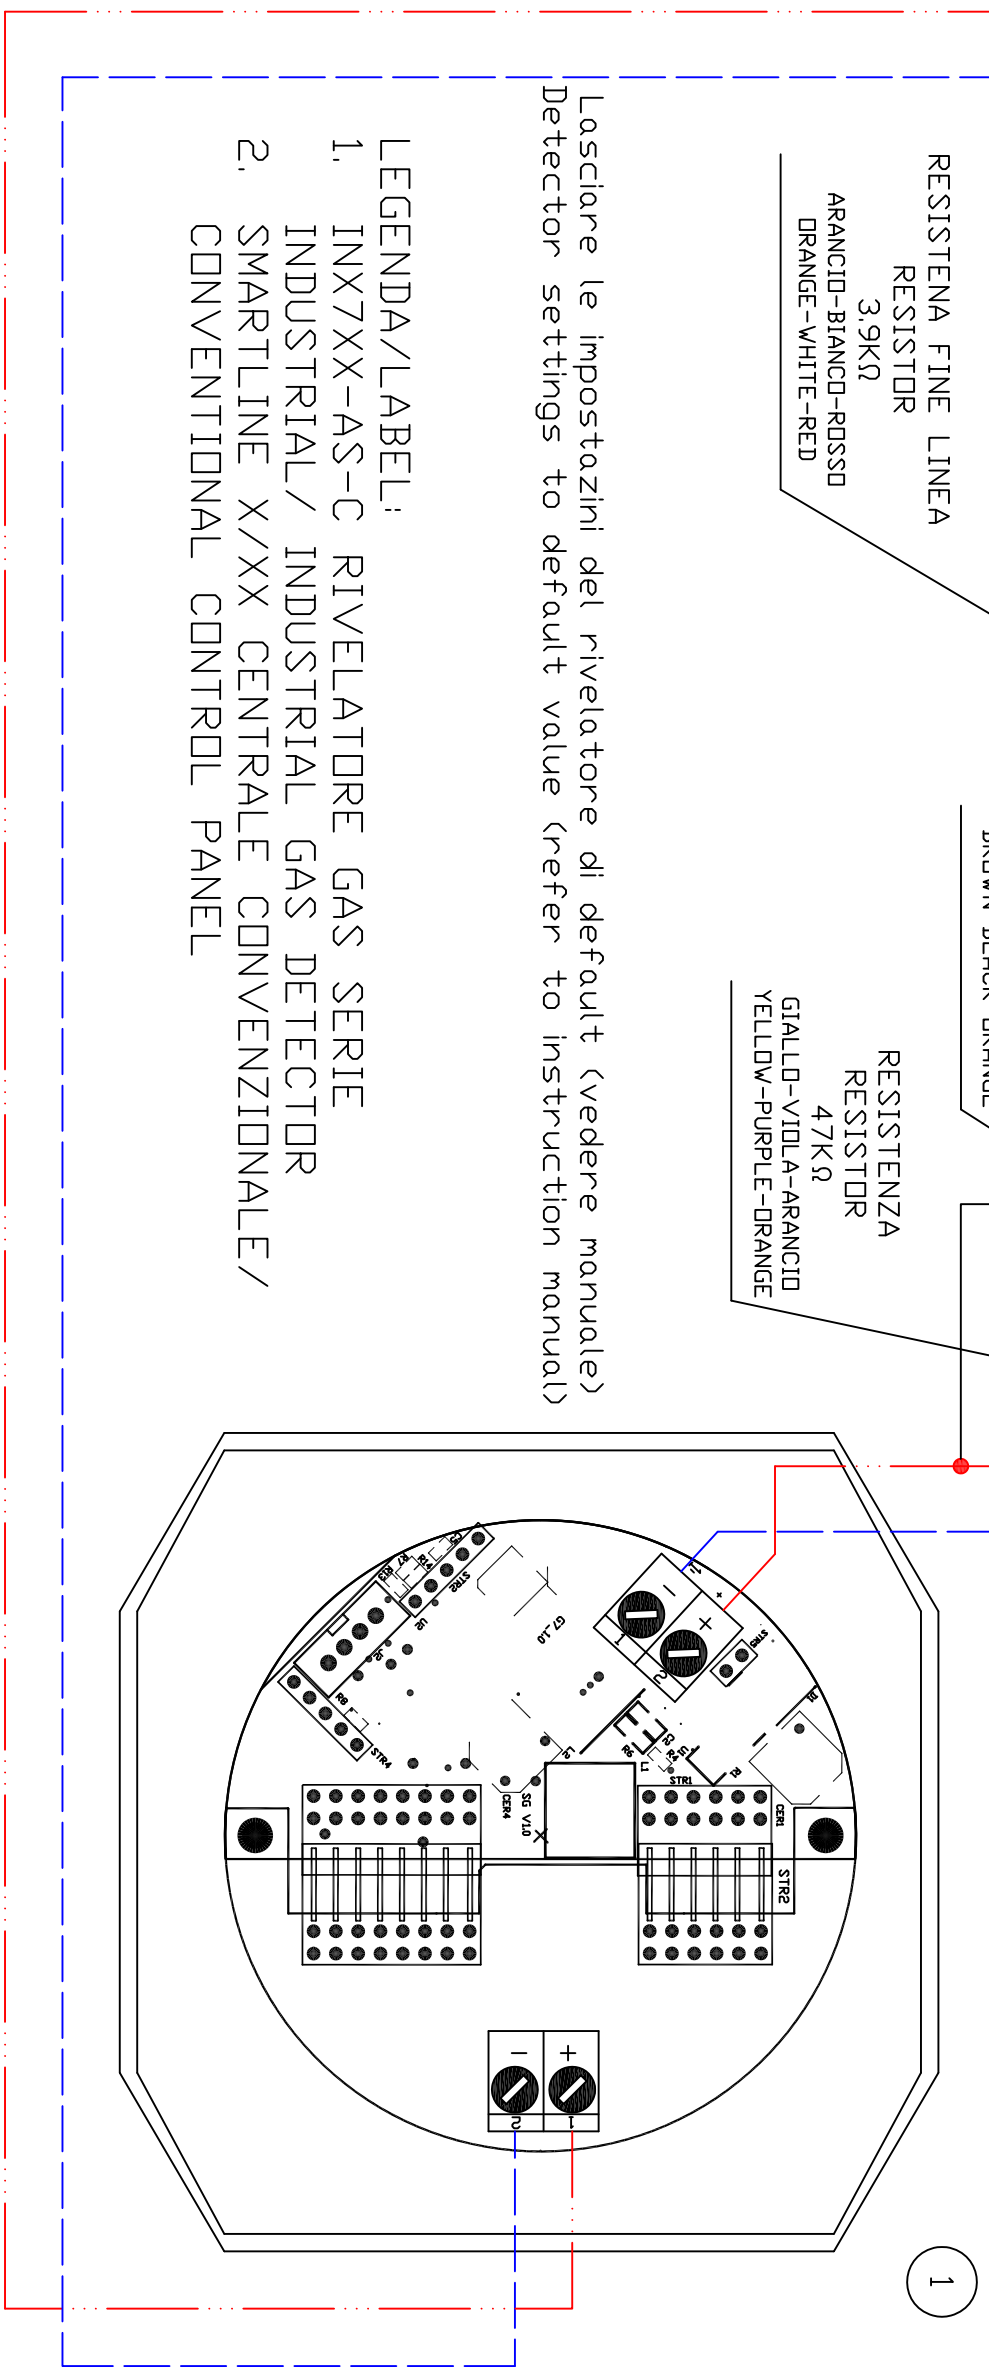

inim
ELECTRONICS
Http://www.inim.biz

GAS INDUSTRIAL to SMARTLINE Zone

ITD080

Rev. 1.0 Data 26/09/'16